



**SA100RS X Series**

**Switchgear Analyser  
Breaker Testing**

# Switchgear Analyser

## Introduction

Weis is a specialist company with over 40 years of experience in the commissioning, testing & maintenance of switchgear and power network fault monitoring within the Power Utility Industry.

Based on advanced features of its successful SA100 Switchgear Analyser, Weis has created the SA100RS X Series version providing a light weight, lower cost, robust switchgear test set for performance analysis on high, medium and low voltage circuit breakers with the options ...

SA100RS X Series : Standard version.  
Operation via external PC.  
SA100RS X Series *travel+* : 3 additional Travel channels.

### OPTIONAL ITEMS

**Cable Sets** - A range of standard cable sets & special made cable sets are available on request.

**Transducers** - A full range of transducers and universal mounting arms are available on request.

**Transportation Cases** - Robust purpose made transportation cases are available for the complete range of products.


**Computer** - Laptop computer for operation of SA100RS X Series Switchgear Analyser.

*Possible test results which can be computed per phase for each breaker operation include:-*

*Peak Coil Current, Current Pulse Length, Operate Times (Main / Resistive), Operate Time Spread (Main / Resistive), On Time, Dead Time, Contact Separation, Datum Velocity, Velocity at Contact Touch, Stroke, Contact Length (Main / Resistive), Spring Compression on Vacuum Contacts, Travel Overshoot, Rebound, Bounce Time, Mechanism Times (Pre Latch / Latch Period), Acceleration and Fingerprint Comparison on all channels (Grey Zone Checking).*

## Features

- ◆ ROBUST SWITCHGEAR TEST AND ANALYSIS SYSTEM FOR PORTABLE OR FACTORY USE
- ◆ OPERATION VIA NETWORK CONNECTION TO WINDOWS™ XP / 7 / 10 BASED EXTERNAL PC RUNNING WEIS BTA SOFTWARE
- ◆ COMPUTED RESULTS WITH CUSTOM REPORT FORMAT FEATURE, REDUCING TEST TIME
- ◆ CREATE A ELECTRONIC LIBRARY OF BREAKER TEST SETTINGS AND SIGNATURES
- ◆ REVISED CONFIGURATION / RECALCULATION ON PREVIOUS TESTS CAPABILITY
- ◆ INDEPENDENT CONTROL OF TRIP AND CLOSE AC OR DC COILS ◆ 1st TRIP ON-LINE PROFILE CAPTURE
- ◆ 6 ANALOGUE INPUT FOR: 1 x DUAL RANGE (5 / 30A) TRIP AND CLOSE COIL CURRENT, 1 x TRAVEL, 3 x USER CONFIGURABLE
- ◆ 10 DIGITAL INPUTS FOR: TIMING OF UP TO 4 MAIN AND 4 RESISTIVE CONTACTS, 2 x TIMING CONTACTS (24-250V DC or 0V)
- ◆ CALCULATED INPUTS FOR: VELOCITY AND ACCELERATION FROM TRAVEL INPUT
- ◆ SA100RS X Series CAN DYNAMICALLY TEST ONE BREAK PER PHASE (EXTERNAL BATTERY SOURCE(S) REQUIRED)
- ◆ ANALOGUE CALCULATIONS PERFORMED ACROSS ALL THREE PHASES AGAINST SINGLE POLE MOTION / TRAVEL SENSING
- ◆ SOFTWARE WIZARD TO SIMPLIFY TEST CONFIGURATION ◆ SUBSTATION ENVIRONMENT PROVEN

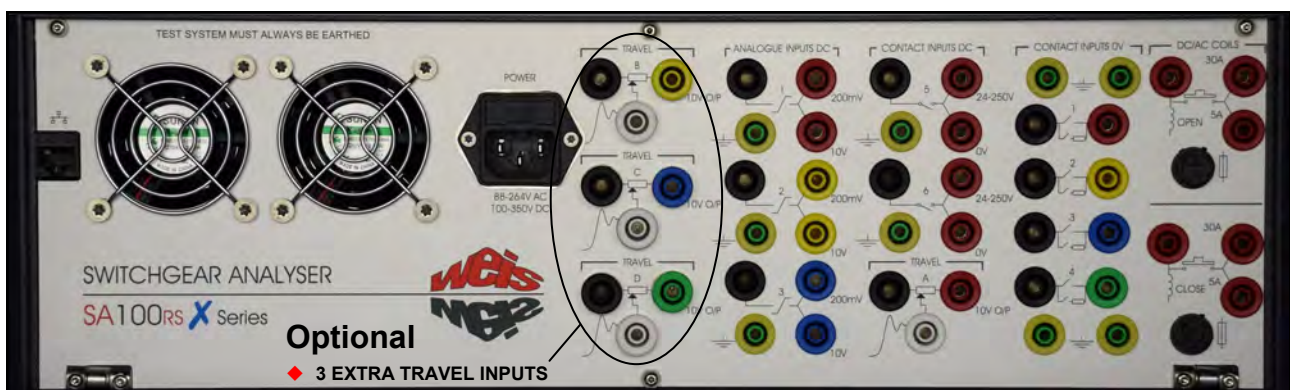

## Data Management

Breaker Test & Analysis software is an essential 32-bit Windows™ database program that provides an easy to use operator interface for configuring & displaying the SA100RS X Series test results in graphical and text report formats.

### Features:-


- ◆ Operator interface for Regular (via Wizard) or Advanced users
- ◆ Results automatically computed with feature to recalculate on configuration change of any existing test record
- ◆ Graphical display of captured waveforms with measurement cursors
- ◆ Standard or user defined report format ◆ Archiving of all tests and configurations
- ◆ Fingerprint comparison on all channels (grey zone checking)

BTA software runs on a standard IBM compatible PC with a Windows™ XP, 7 or 10 operating system. Communication to control the SA100RS X Series Switchgear Analyser is via an Ethernet connection.

The display and printing of a report can be fully customised to include logo's, in-house styles, text phrases and results format, thus eliminated the need to manually complete a written form in most cases.


# SA100RS X Series

Wizard - Start New or Select Existing Test Configuration

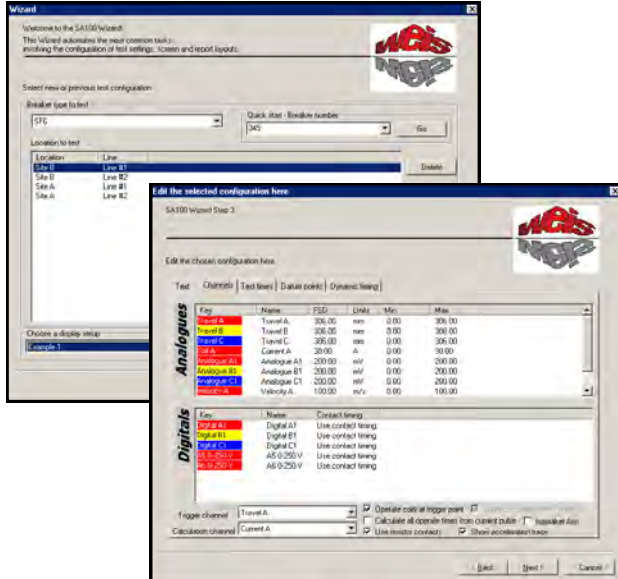

Wizard (Step 3) - Channel Settings

Wizard (Step 2) - Breaker Test Connections

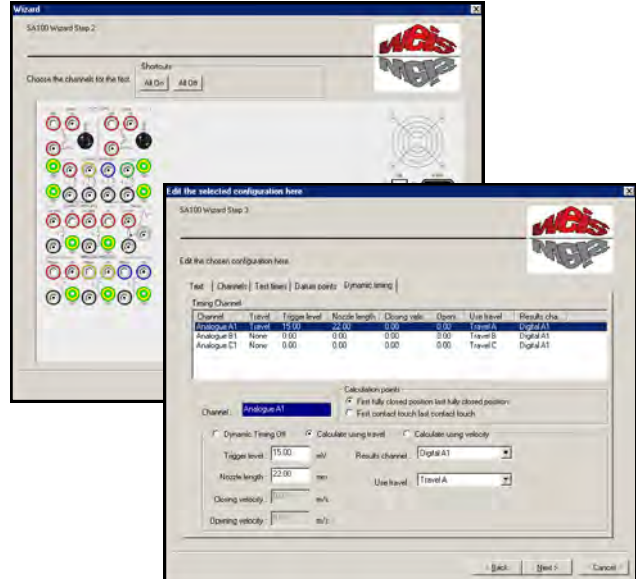

Wizard (Step 3) - Dynamic Test Settings

## Graphical Display



### Graphical Features

- Zoom - Time Base
- Zoom - Amplitude
- Cursors - Measured Value & Time
- Colours - Traces & Background
- Font - Text Style & Size
- Print - Screen as Displayed
- Add Calculated Channels
- Combine Test Records - Overlay Traces
- Select Pre-defined Display Setups


### Advanced Analysis

- Acceleration Trace Computed from Travel
- Velocity Trace computed from Travel
- All Graphical View Features Supported

### Report Features

- Customise which Results are shown
- Edit Headings
- Change Font - Text Style, Size & Colour
- Select Pre-defined Report Setups

## Acceleration & Velocity

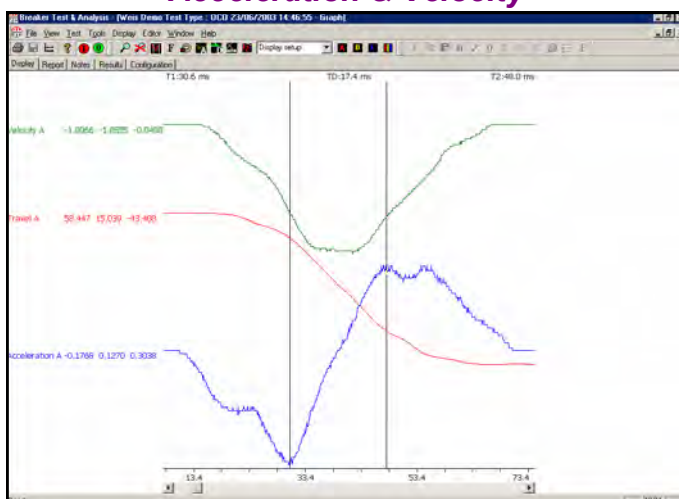

## Text Report

Breaker Test & Analysis - [123 Weiss Broomen (Demo) Test Type: UCU Result: 02/02/2001 13:29:43 - Report]			
Display   Report   Notes   Results   Configuration			
Site Name : Weiss Broomen (Demo)			
Breaker Number: 123			
Breaker Type : 400KV SF6			
Line Name : Line #1			
Operator Name : B. Tester			
Test Type : OCO			
Test Date : 02/02/2001			
Test Time : 13:29:43			
Dead Time	326.10	324.80	327.20 ms
On Time	31.70	31.60	32.90 ms
Operation 1 Results			
Current	2.22	A	
	Phase A	Phase B	Phase C
Operate Time	22.30	22.90	22.30 ms
Operate Time Spread	0.00	0.00	0.00 ms
Operate Time (res)	23.30	23.90	23.30 ms
Operate Time Spread (res)	0.00	0.00	0.00 ms
Contact Times #1	22.30	22.90	22.30 ms
Contact Times #1 (res)	23.30	23.90	23.30 ms
Overshoot Time	18.70	24.10	23.20 ms
Velocity	5.11	5.19	5.21 m/s
Velocity (2)	5.11	5.19	5.21 m/s
Terminal Velocity	1.22	0.38	0.69 m/s
Stroke	116.12	116.12	116.12 mm
Contact Length	33.57	34.64	34.79 mm
Contact Length (res)	38.76	39.98	40.44 mm
Contact Separation	82.55	82.70	81.18 mm
Contact Separation (res)	77.36	77.36	75.53 mm
Overshoot	4.73	4.73	4.73 mm
Rebound	0.76	0.76	0.76 mm

# Switchgear Analyser

# SA100RS X Series

## Specifications

### INPUTS

**Analogue:** 1 x Independently controlled trip (open) and close coil current inputs.  
1 x Linear / rotary resistive travel transducer input, will calculate all 3 phases. **3 extra with *travel+* option.**  
3 x User configurable 0 - 10V DC or 0 - 200mV DC inputs, selected via input sockets.  
**Analogue Accuracy:** Calibrated to 0.024%,  $\leq \pm 0.5\%$  of reading,  $\leq \pm 0.1\%$  of fullscale.  
**Digital:** 10 x Contact status inputs providing timing of up to 6 main contacts and 4 resistive contacts ('dry' contacts).  
Note: 2 contact status inputs are user configurable for 'wet' or 'dry' contact timing (24 - 250V DC or 0V DC).  
**Resistive Contact Range:** 15 - 10,000 ohms. **Digital Resolution:** 0.1ms. **Connectors:** 4mm safety socket.

### OUTPUTS

**Coil Operation:** Solid state outputs for trip (open) and close.  
**Coil Peak Current:** 5A (accuracy 2.5mA) or 30A (accuracy 15mA) AC/DC measurement ranges selectable via input sockets.  
Other measurement ranges possible via optional external shunt; for example 50A Peak (up to 75mS duration) or 100A Peak (up to 50mS duration).  
**Coil Max. Voltage:** 400V peak.

### RECORDING

**Resolution:** 12 bit A/D (1:4096, 0.024%). **Sample Rate:** 10kHz.  
**Synchronisation:** All inputs sampled simultaneously. **Recording Time:**  $\infty$  due to trigger option on all channels.  
**Start trigger:** Coil current or selectable on any analogue / digital input. **1st Trip:** 1st trigger selectable on any channel.

### GENERAL SYSTEM

System Operation: RJ45 network port to external PC with Windows™ XP, 7 or 10 Operating System running Weis Breaker Test & Analysis software.

**Green** LED for internal operating system READY status indication.  
Safety keyswitch to enable/disable coil operation.

### REAL-TIME CLOCK

**Range:** Time, date, leap year and day of the year with internal battery backup. 100mS resolution.

### PROGRAMMING - SETTABLE PARAMETERS

**User strings:** Site name, breaker number, breaker type, line name, operator name and up to 30 user configurable.  
**Test times:** Close, Open, Trip Free, Close-Open, Open Close, Open-Close-Open.  
**Coil operate times:** Initial delay, trip coil "on-time", close coil "on-time", delay time between closing and opening, delay time between opening and closing.  
**Channels:** Analogue - Input name, fullscale value, units. Digital - Input name.  
**Datum points:** 2 sets of velocity calculation points on travel (speed) curve.

### COMPUTED RESULTS

**Up to a sequence of 3 operations detailing 3-phase information:**

Peak coil current, operate times and operate time spread (main/resistive), on time, dead time, datum velocity, velocity at contact touch, acceleration, stroke, contact length (main/resistive), contact separation, spring compression on vacuum contacts, travel overshoot, bounce time and rebound.

**Acceleration and velocity:**

Graphical trace derived for measured travel input with cursor measurement.

**Parallel Contact (P.I.R.) Switching Resistors:**

Graphical traces for each with cursor measurement. Measurement of up to 4 PIR's or 6 PIR's with *travel+* option.

### OPERATING VOLTAGES

**Prime Power:** 100 to 370V DC, 90 to 264V AC auto-sensing via IEC power connection. Burden <60 VA.

### ENVIRONMENTAL

**Operating Temp.:** -20°C to +70°C (-4°F to +158°F) **Humidity:** 0 to 97% RH non-condensing.  
**Isolation:** 2kV rms for 1 minute (channel to channel, channel to earth).  
**Surge Withstand:** To IEC 801-5. 1.2/50μS.  
**(Transient)** Common Mode: Severity level class 4. Series Mode: Severity level class 3.  
**Fast Transient Burst:** To IEC 801-4 level 3.  
**RFI Immunity:** To IEC801-3 level 3. 10V/m 26-1000MHz. **Emissions:** To EN50081-1: 1992.

### MECHANICAL DETAILS

**Enclosure:** 3U steel enclosure suitable for Euro 19" wide rack mounting or free standing (tabletop).  
**Ventilation:** Fan assisted. **Weight:** <7kg.  
**Optional Carry Case:** Reinforced aluminium, 545mm(W) x 380mm(H) x 205mm(D).

DUE TO CONTINUING DEVELOPMENT AND IMPROVEMENTS WEIS RESERVES THE RIGHT TO CHANGE THIS SPECIFICATION WITHOUT NOTICE  
Windows is a trademark for Microsoft Inc.

#### HEAD OFFICE

**WEIS GMBH & Co. KG**

Kaffeestrasse 4  
28779 Bremen  
Germany  
Tel: +49 (0) 421 606040  
Fax: +49 (0) 421 607066  
Email: WeisGmbHBremen@t-online.de

#### LOCAL REPRESENTATIVE



#### UK OFFICE

**WEIS GMBH & Co. KG**

'Bay Trees' 47 Beltinge Road  
Herne Bay  
Kent CT6 6DA  
UK  
Tel: +44 (0) 1227 749413  
Email: sales@WeisGmbH.net